




OLD STONEY REMODEL
PHASE ONE
108 NORTH 4TH STREET
SUNDANCE, WYOMING 82729

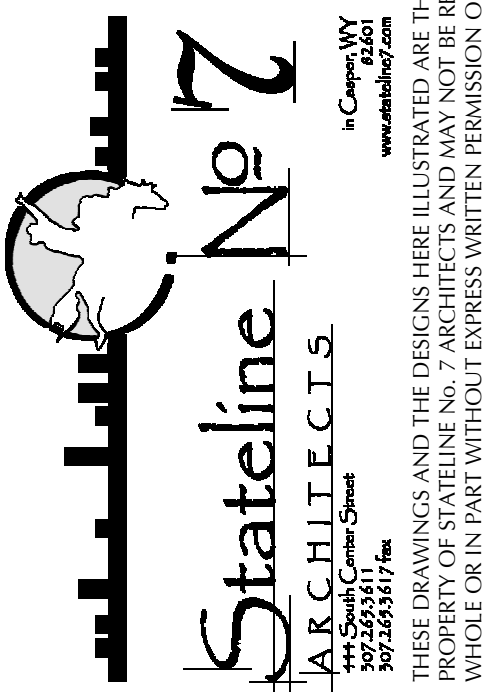

PROJECT
16-025

DATE
11/20/17

DRAWN
NAO

DISK

SHEET
SUB-BASEMENT

SHEET


2.10

- FOUNDATION PLAN NOTES:**
- NOT ALL EXISTING ELEMENTS ARE SHOWN. THE INTENT IS TO SHOW ITEMS ADJACENT AND RELATIVE TO NEW STRUCTURAL ELEMENTS. CONTRACTOR TO FIELD VERIFY SIZE AND LOCATION OF (E) ELEMENTS PRIOR TO FABRICATION OR CONSTRUCTION OF NEW WORK.
 - NEW OPENINGS IN EXISTING MASONRY NOT SHOWN ON STRUCTURAL DRAWINGS SHALL BE SUBMITTED FOR REVIEW PRIOR TO CUTTING.
 - SEE ARCHITECTURAL AND MECHANICAL DRAWINGS FOR EQUIPMENT PAD SIZES & LOCATIONS.
 - REFER TO ARCHITECT'S DRAWINGS FOR ADDITIONAL INFORMATION OF DEMOLISHED AND MODIFIED (E) ELEMENTS.
 - CONTRACTOR SHALL STABILIZE SOILS AND PROTECT INTEGRITY OF EXISTING STRUCTURE PRIOR TO EXCAVATION & FOR THE DURATION OF THE NEW WORK; SEE EXCAVATION NOTES ON 2.01. VERTICAL LOADS ON STRUCTURE FOR DELEGATED SHORING DESIGNS ARE AS FOLLOWS:
PERIMETER WALLS:
- DL = 12 KLF
- LL CONST = 0.5 KLF
- LL FINAL = 2.5 KLF
BASEMENT WALL ALONG GL 4:
- DL = 3 KLF
- LL CONST = 0.7 KLF
- LL FINAL = 3 KLF
PILASTERS:
- DL = 35 K
- LL CONST = 15 K
- LL FINAL = 80 K

- SYMBOLS:**
- X'-XX" DIMENSIONS TO EXISTING STRUCTURE, FIELD VERIFY (ASTERISK)
 - SLAB TYPE
 - SLAB THICKNESS
 - SOGXX T/SLAB
 - XXX'-XX" T/SLAB
 - F1- FTG MARK (SF = STRIP FTG)
 - XX'-X" T/FTG EL
 - CXX COLUMN SIZE OR MARK
 - BP-X BASE PLATE TYPE
 - WC(#)- WOOD COLUMN MARK (#), SEE 6/2.36
 - WB(#)- WOOD BEAM MARK (#), SEE 9/2.36

- TYPICAL DETAIL REFERENCES**
- 17/2.30 FOR CONCRETE REINFORCING REQUIREMENTS
 - 17/2.30 FOR SLAB ON GRADE KEY PLAN
 - 11/2.30 FOR SPREAD FOOTINGS SCHEDULE AND REQUIREMENTS
 - 10/2.30 FOR BASE PLATES
 - 6/2.31 FOR TYPICAL HORIZ WALL REIN AT CORNERS AND INTERSECTIONS
 - 2/2.36 FOR WOOD FRAMING NAILING

- KEYNOTES:**
- NEW PENETRATION IN (E) STONE FOR NEW LOUVERS, 115"(W) x 61"(H) MAX. DO NOT OVER CUT
 - PROTECT NEW WOOD COLUMNS ADJACENT TO (E) STONE WALLS WITH MOISTURE BARRIER COATING
 - POST LOCATED TO AVOID/CLEAR (E) W6 AND FIT WITHIN NEW FURRING WALLS, CONTRACTOR TO FIELD VERIFY.
 - ELEVATOR PIT AND SHAFT TO BE COORDINATED WITH ELEVATOR SELECTED
 - HATCHED REGION INDICATES EXTENTS OF NEW CONC BEAMS, SEE 11/2.31
 - DIMENSION IS FOR BIDDING PURPOSES ONLY. LOCATE NEW SLAB EDGE TO MAINTAIN A MINIMUM OF 1:1 SLOPE, OR AS RECOMMENDED OR REQUIRED BY GEOTECHNICAL ENGINEER TO AVOID EXCAVATION SOIL SHORING, FROM BOTTOM EDGE OF (E) FOOTING TO SLAB AS SHOWN IN 8/2.31
 - CONC EQUIPMENT PADS, SEE ARCH AND MECHANICAL FOR LOCATION AND EXTENTS. SEE 8/2.30
 - HIGH DENSITY SHELVING UNITS, SEE 12/2.31 COORD SIZE, DEPRESSIONS, AND OTHER REQUIREMENTS WITH ARCH AND SHELVING UNITS.

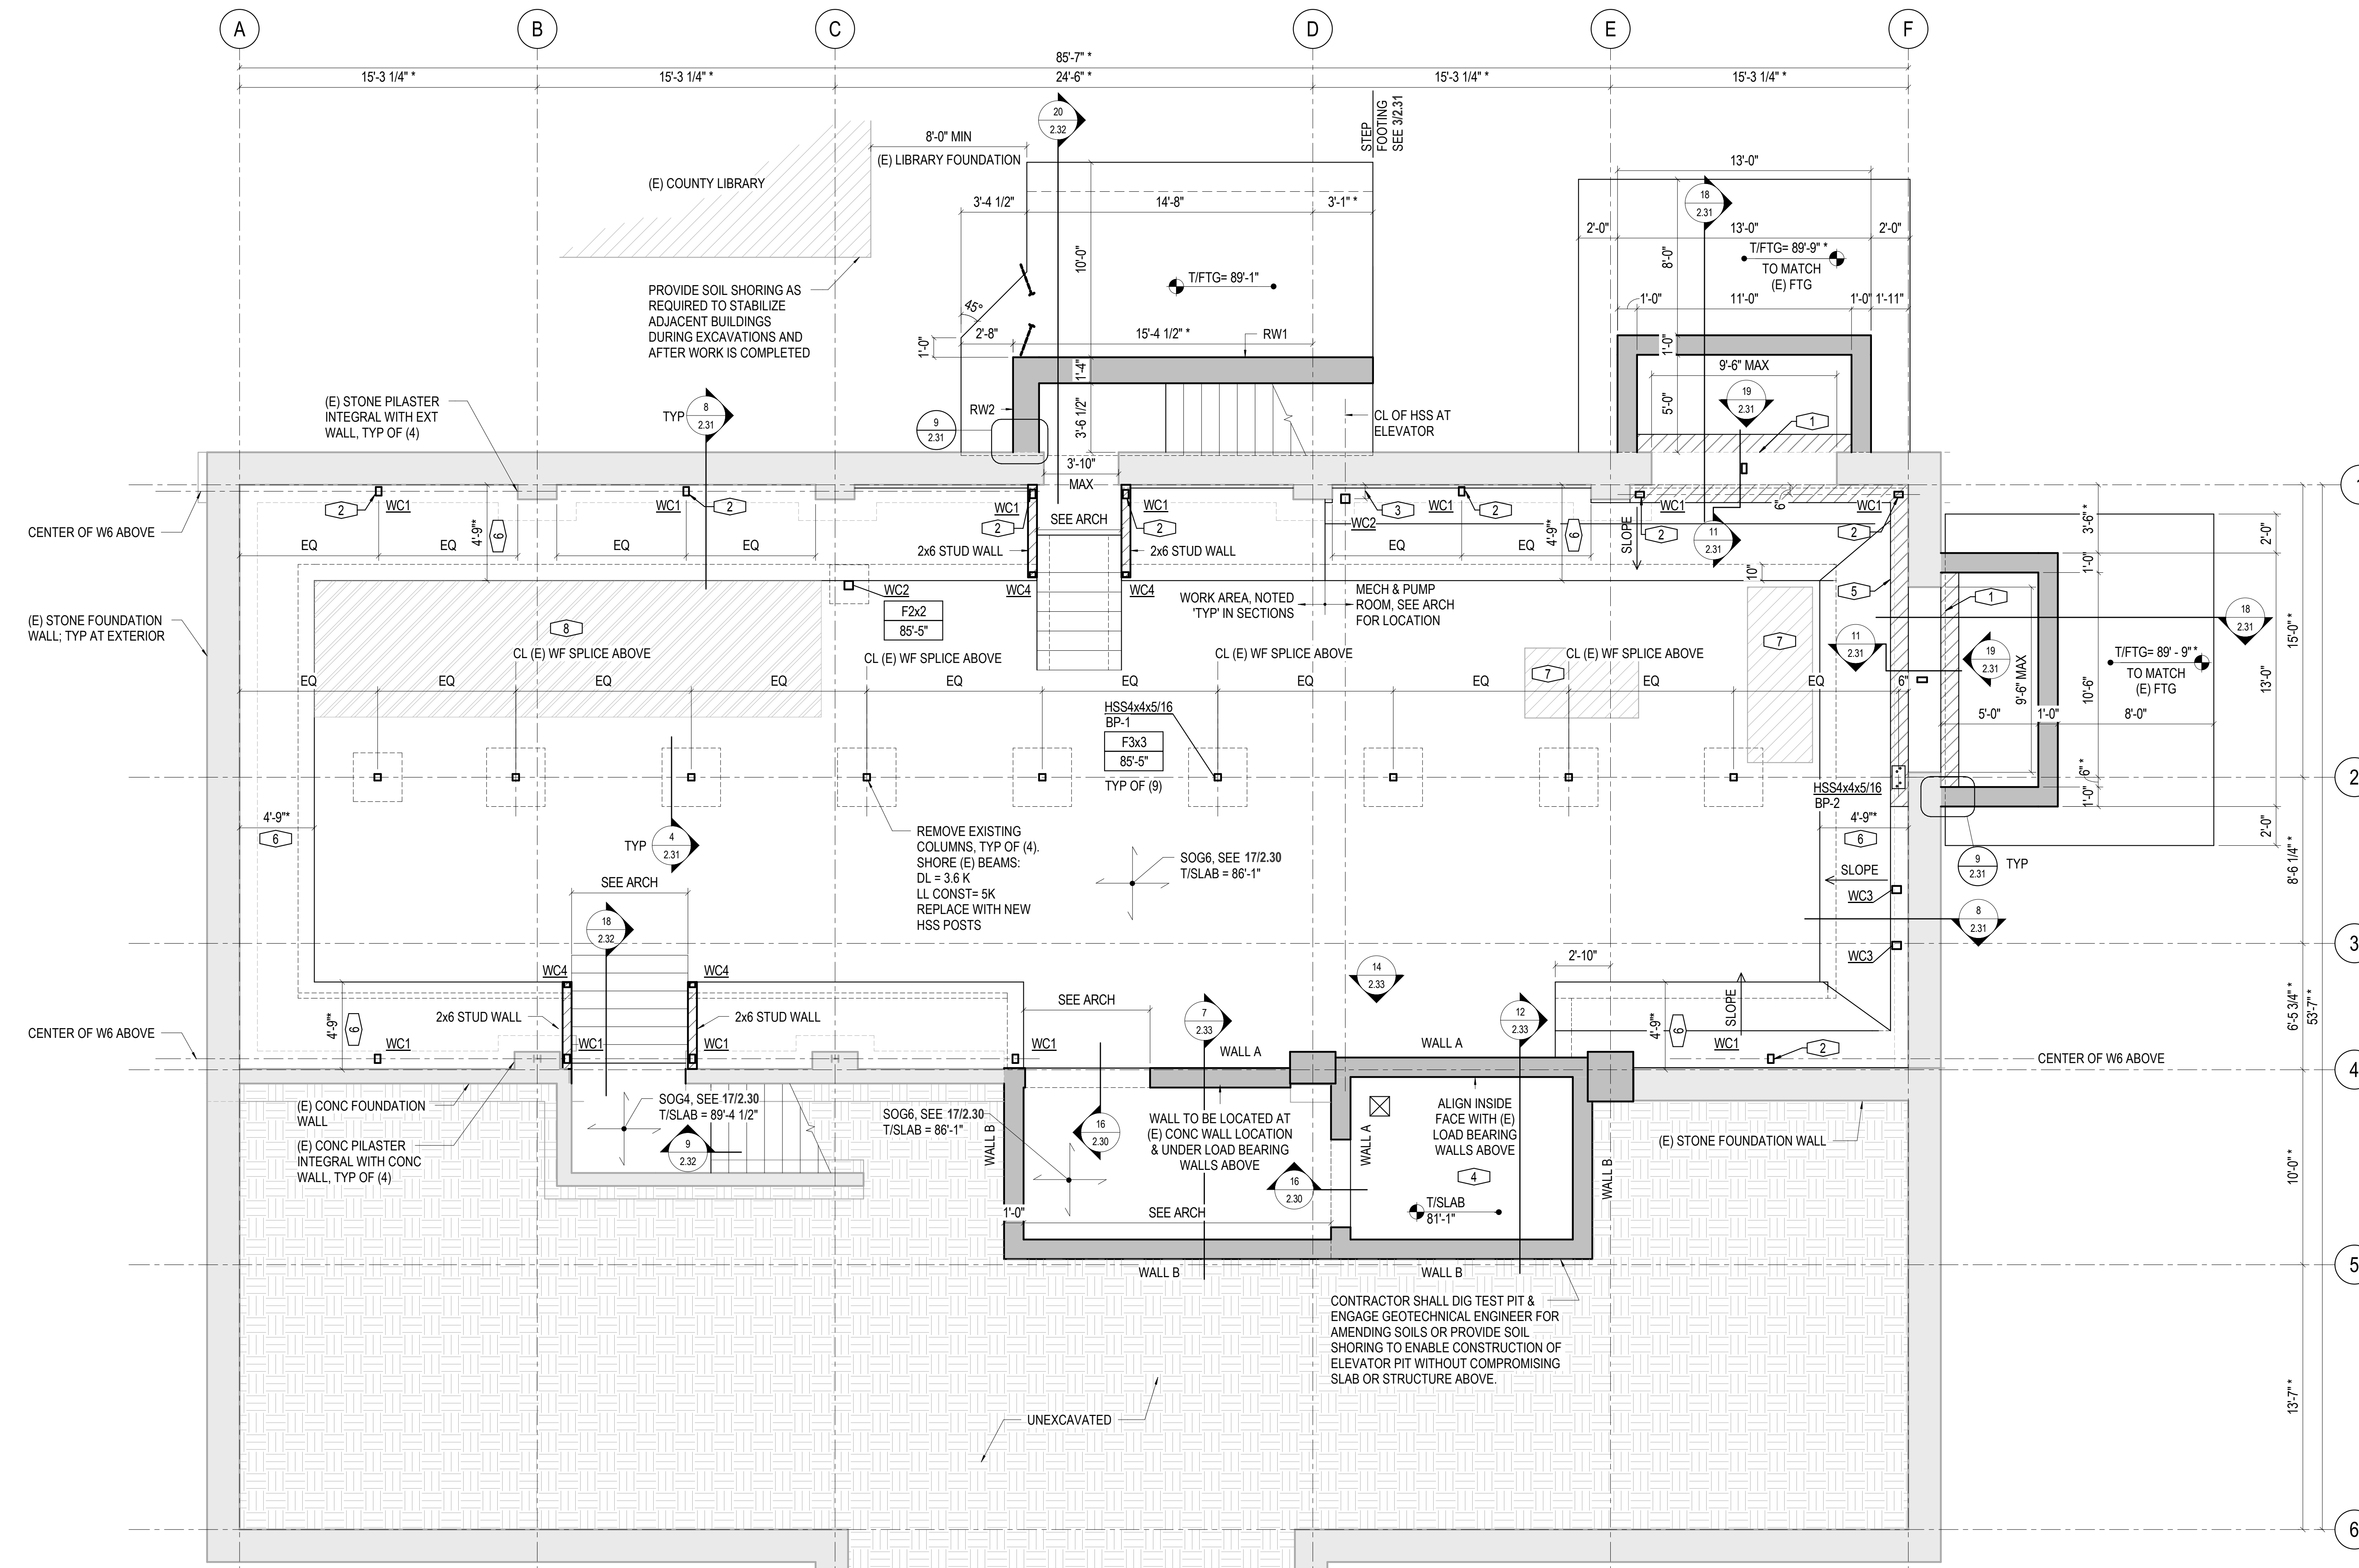

SUB-BASEMENT
1/4" = 1'-0"
NORTH