



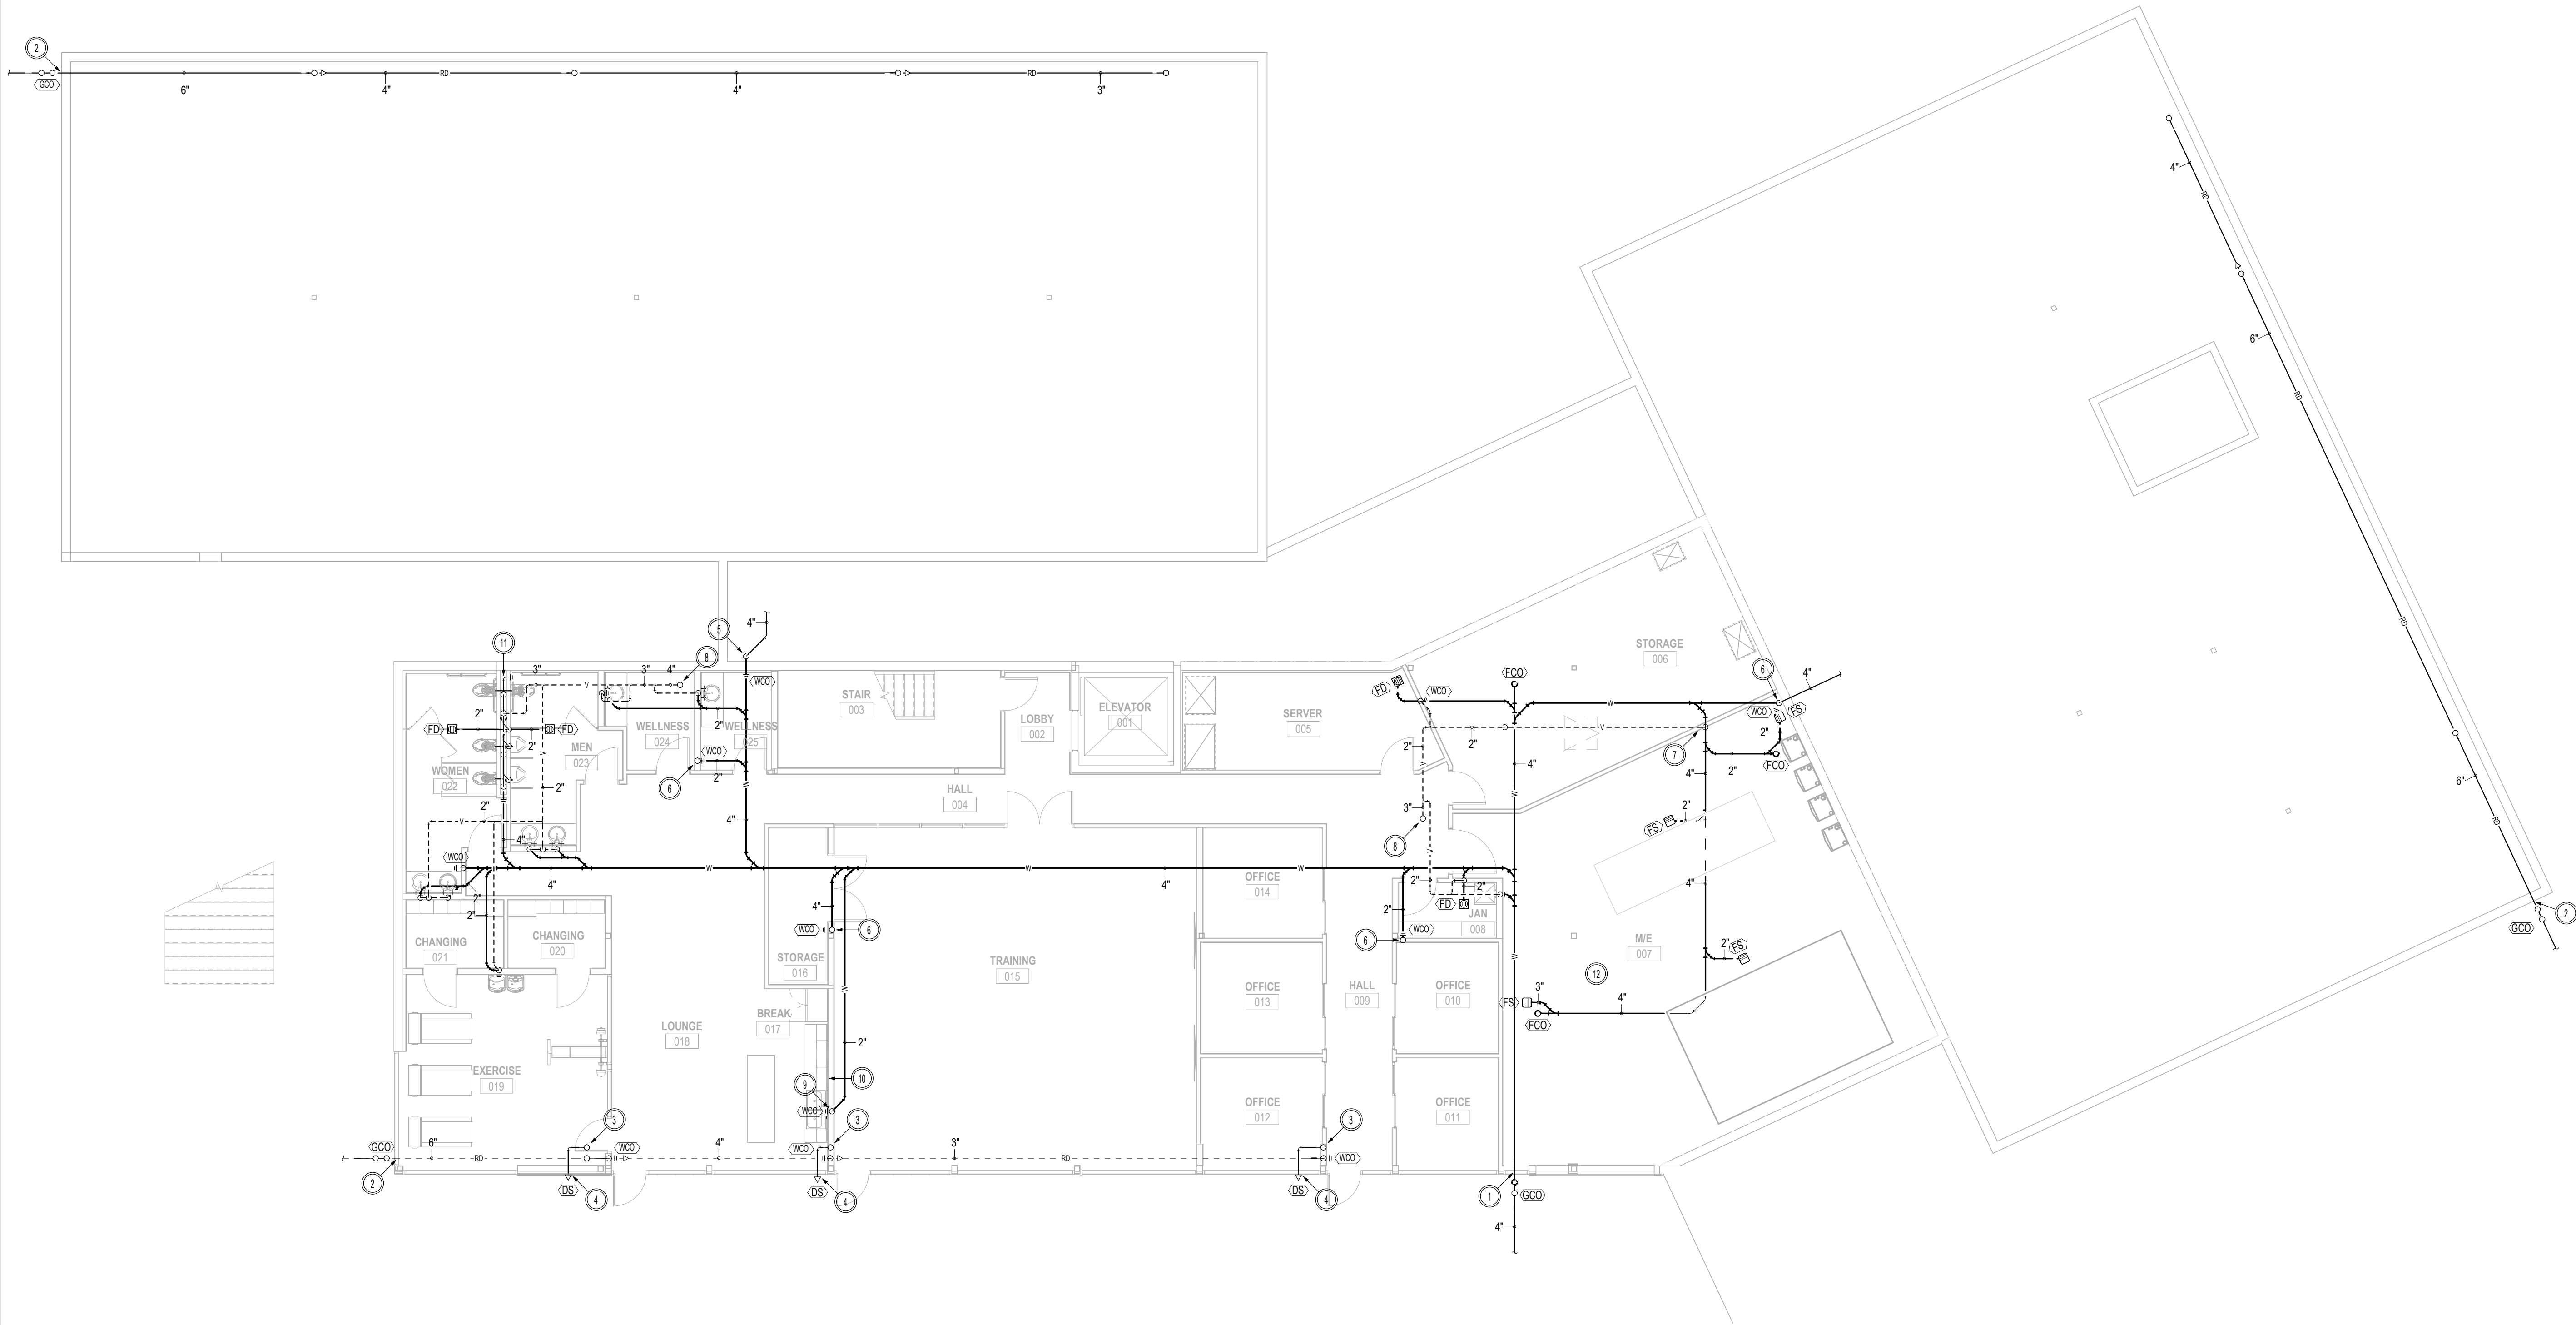


GENERAL NOTES


- A. INSTALL ALL PLUMBING PIPING WITHIN FRAMED WALLS OR ABOVE CEILINGS TIGHT TO OR WITHIN STRUCTURE UNLESS NOTED OTHERWISE. COORDINATE LOCATIONS WITH OTHER TRADES PRIOR TO INSTALLATION. PLAN OFFSETS AS REQ'D TO AVOID CONFLICTS WITH DUCTWORK AND/ OR STRUCTURE.
- B. COORDINATE ALL INSTALLATIONS WITH STRUCTURE. PROVIDE SLEEVES OR BLOCK-OUTS WHERE REQ'D. INSTALL OFFSETS ACCORDINGLY. CONSULT THE DESIGN TEAM PRIOR TO DISRUPTING STRUCTURAL ELEMENTS.
- C. FLOOR DRAIN LOCATIONS ARE SHOWN APPROXIMATE. CONFIRM ALL LOCATIONS WITH THE ARCHITECT PRIOR TO ROUGH-IN AND SET FINAL ELEVATION TO ACCOMMODATE SLOPING FLOORS.

KEY NOTES

- 1. APPROX MIN SANITARY BLDG DRAIN INVERT IS 84.5-FT. SLEEVE FOUNDATION OR ROUTE UNDER FOOTINGS. SLOPE ALL DRAINS 1/4-IN PER FOOT MIN. COORDINATE DEPTH AND LOCATION WITH CIVIL.
- 2. APPROX MIN ROOF DRAIN INVERT IS 95.5-FT. SLEEVE FOUNDATION OR ROUTE UNDER FOOTINGS. SLOPE DRAINS 1/4-IN PER FT MIN. COORDINATE DEPTH AND LOCATION WITH CIVIL.
- 3. OFFSET AND INSTALL INSULATED ROOF DRAIN LEADER DOWN WITHIN WALL FRAMING. INSTALL STACK CLEAN-OUT JUST ABOVE THE FLOOR. CONTINUE PIPING INTO THE CRAWLSPACE.
- 4. INSTALL INSULATED OVERFLOW DRAIN DOWN FROM ABOVE AND EXTEND THRU THE EXTERIOR WALL TO DISCHARGE SPOUT HIGH-UP AT APPROX 11'-6" AFF. COORDINATE WITH THE GC.
- 5. EXTEND WASTE PIPE UNDER THE FOUNDATION AND UP INTO THE ADJOINING CRAWL SPACE. CONFIRM INVERT ELEVATION AND SLEEVE FOUNDATION WALL ACCORDINGLY.
- 6. EXTEND WASTE STACK UP WITHIN CHASE OR WALL FRAMING TO SERVE FIXTURES ABOVE. INSTALL STACK CLEAN-OUT AT THE BASE OF THE RISER.
- 7. EXTEND VENT LINE UP WITHIN WALL FRAMING SERVING COMBINATION DRAIN AND VENT SECTION.
- 8. COMBINE SANITARY VENTS HIGH-UP AND EXTEND UP WITHIN WALL FRAMING ABOVE.
- 9. OFFSET AND EXTEND SANITARY VENT UP WITHIN WALL FRAMING ABOVE.
- 10. CONNECT DISHWASHER DRAIN TO FOOD GRINDER OR TAIL PIECE UPSTREAM OF THE ADJOINING SINK.
- 11. SEE PLUMBING ISOMETRICS FOR ADDITIONAL WASTE AND VENT SCOPE OF WORK IN THIS AREA.
- 12. SEE LARGE SCALE PLAN FOR ADDITIONAL WASTE AND VENT SCOPE OF WORK IN THE ME ROOM.

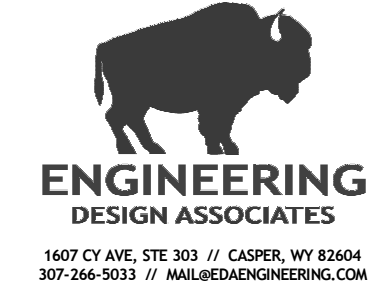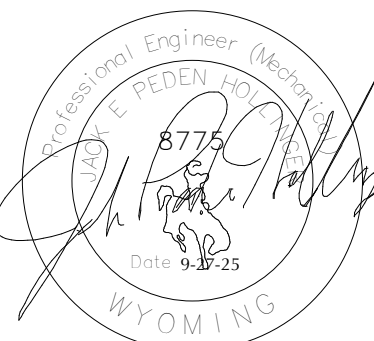

TRONA VALLEY FEDERAL CREDIT UNION
1700 GATEWAY BLVD
ROCK SPRING, WY 82901

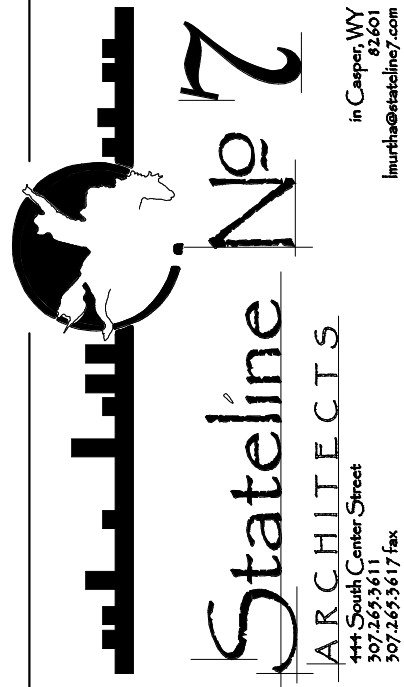

PROJECT
24112

DATE
09-27-2025

DRAWN BY
GMH

DISK ID.

SHEET
BASEMENT LEVEL
DRAIN WASTE &
VENT

SHEET

15.20