


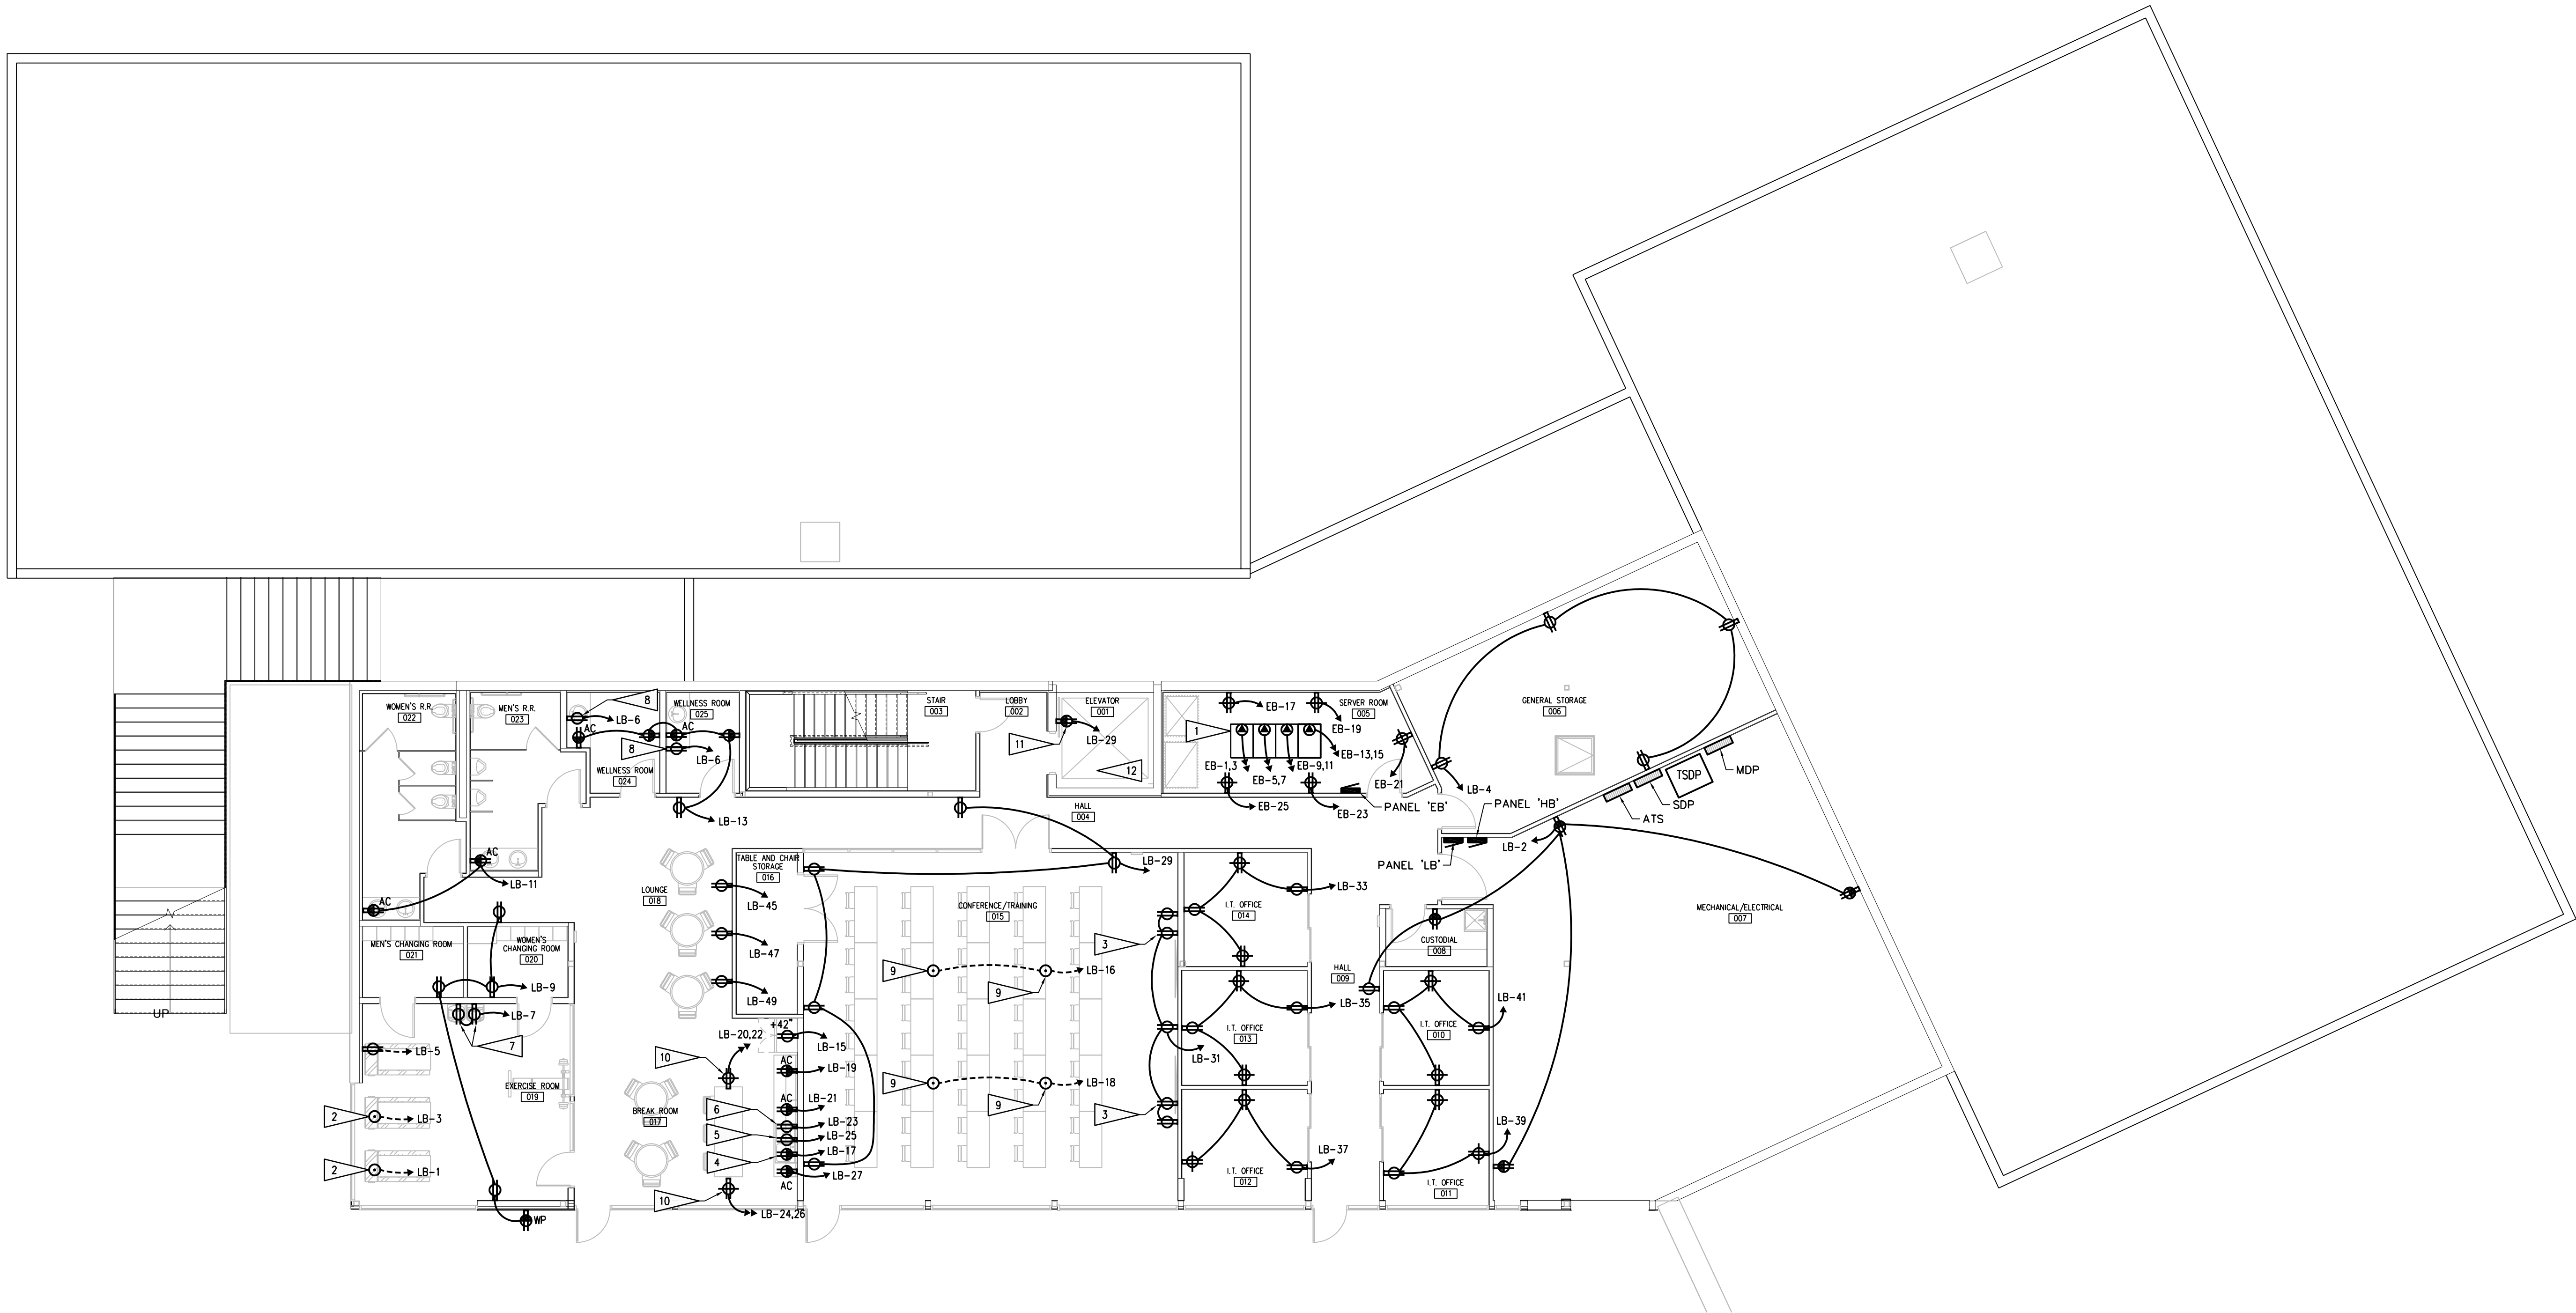

FLAG NOTES		GENERAL NOTES	
1	PROVIDE (1) NEMA L6-30R ABOVE EACH DATA RACK/CABINET AND MOUNT TO LADDER TRAY. CONNECT EACH RECEPTACLE TO A DEDICATED CIRCUIT AS SHOWN.	10	MOUNT RECEPTACLE NOTED RECESSED INTO SIDE OF BUILT IN TABLE LEG. ROUTE CIRCUITING IN BUILT IN TABLE LEG. SEE ARCHITECTURAL TABLE DETAILS. CONNECT EACH DUPLEX RECEPTACLE TO A DEDICATED CIRCUIT SHOWN.
2	PROVIDE IN-FLOOR 4" FLOOR POKE-THRU WITH (1) NEMA 5-20 RECEPTACLE AND ONE 1-PORT DATA OUTLET. FLOOR BOX SHALL BE LEGRAND 44TCP2 AND FLANGED COVER OR ACCEPTABLE EQUAL. COLOR BY ARCHITECT.	11	INSTALL RECEPTACLE NOTED IN ELEVATOR PIT. LOCATE PER ELEVATOR MANUFACTURER'S DIRECTIONS.
3	INSTALL RECEPTACLE NOTED HIGH ON WALL FOR TELEVISION. COORDINATE INSTALLATION WITH TELEVISION MOUNTING BRACKET. SEE ARCHITECTURAL ROOM ELEVATIONS.	12	ALL EQUIPMENT, DEVICES AND CONNECTIONS FOR ELEVATOR SHALL BE INSTALLED PER NEC 620 AND MANUFACTURERS DIRECTIONS.
4	INSTALL RECEPTACLE NOTED UNDER SINK FOR GARBAGE DISPOSAL. COORDINATE LOCATION WITH PLUMBING CONTRACTOR.		
5	INSTALL RECEPTACLE NOTED IN UPPER CABINETRY FOR MICROWAVE. SEE ARCHITECTURAL ROOM ELEVATIONS.		
6	INSTALL RECEPTACLE NOTED UNDER SINK FOR DISHWASHER. COORDINATE LOCATION WITH PLUMBING CONTRACTOR.		
7	INSTALL RECEPTACLE NOTED BEHIND WATER COOLER COVER AT LOCATION DIRECTED BY MANUFACTURER.		
8	INSTALL RECEPTACLE NOTED UNDER COUNTER FOR UNDER COUNTER REFRIGERATOR. SEE ARCHITECTURAL ROOM ELEVATIONS.		
9	PROVIDE IN-FLOOR 6" FLOOR POKE-THRU WITH (2) NEMA 5-20 RECEPTACLE AND ONE 2-PORT DATA/TELEPHONE OUTLET. FLOOR BOX SHALL BE LEGRAND 64TCP2 WITH DECORATOR STYLE CENTER DEVICE PLATE AND FLANGED COVER OR ACCEPTABLE EQUAL. COLOR BY ARCHITECT.		
		1. SEE SPECIFICATIONS FOR MATERIALS AND METHODS. 2. ELECTRICAL INSTALLATIONS SHALL COMPLY WITH CURRENT ADOPTED NEC, STATE AND LOCAL CODES. 3. INSTALL EQUIPMENT GROUNDING CONDUCTORS IN ALL CONDUITS. 4. CONTRACTORS ARE TO EXAMINE THE SITE AND DOCUMENTS OF OTHER TRADES, AND BECOME FAMILIAR WITH THE FULL SCOPE OF WORK. 5. ALL PENETRATIONS FOR RACEWAY AND WIRE WHICH ARE FURNISHED AND INSTALLED BY THE EC, THAT PENETRATE FLOORS, FIRE AND/OR SMOKE WALLS, AND FULL HEIGHT PARTITIONS (INCLUDING CHASE WALLS) SHALL BE SEALED WITH A SYSTEM SPECIFICALLY UL APPROVED FOR THE APPLICATION, TO MAINTAIN FIRE RATING.	