




TRONA VALLEY FEDERAL CREDIT UNION
1700 GATEWAY BLVD
ROCK SPRINGS, WYOMING 82901

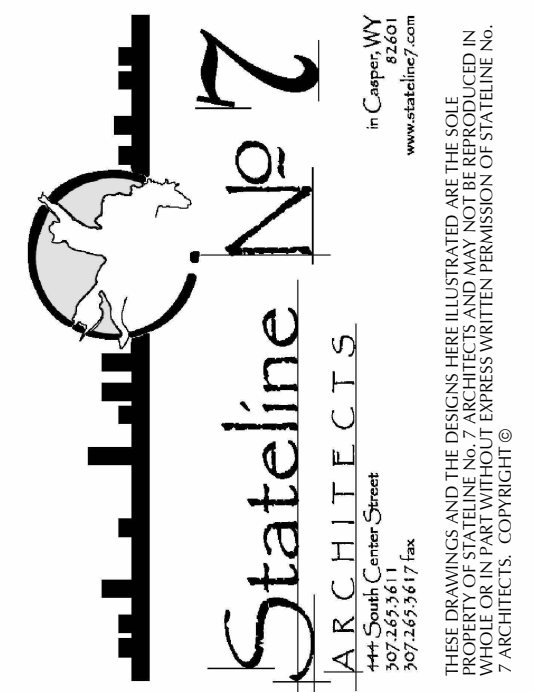

PROJECT NUMBER
23-018

DATE
09-27-2025


DRAWN BY
K LARSEN

DISK ID.

SHEET TITLE
FIRST FLOOR
DIMENSION PLAN

SHEET NUMBER

3.15

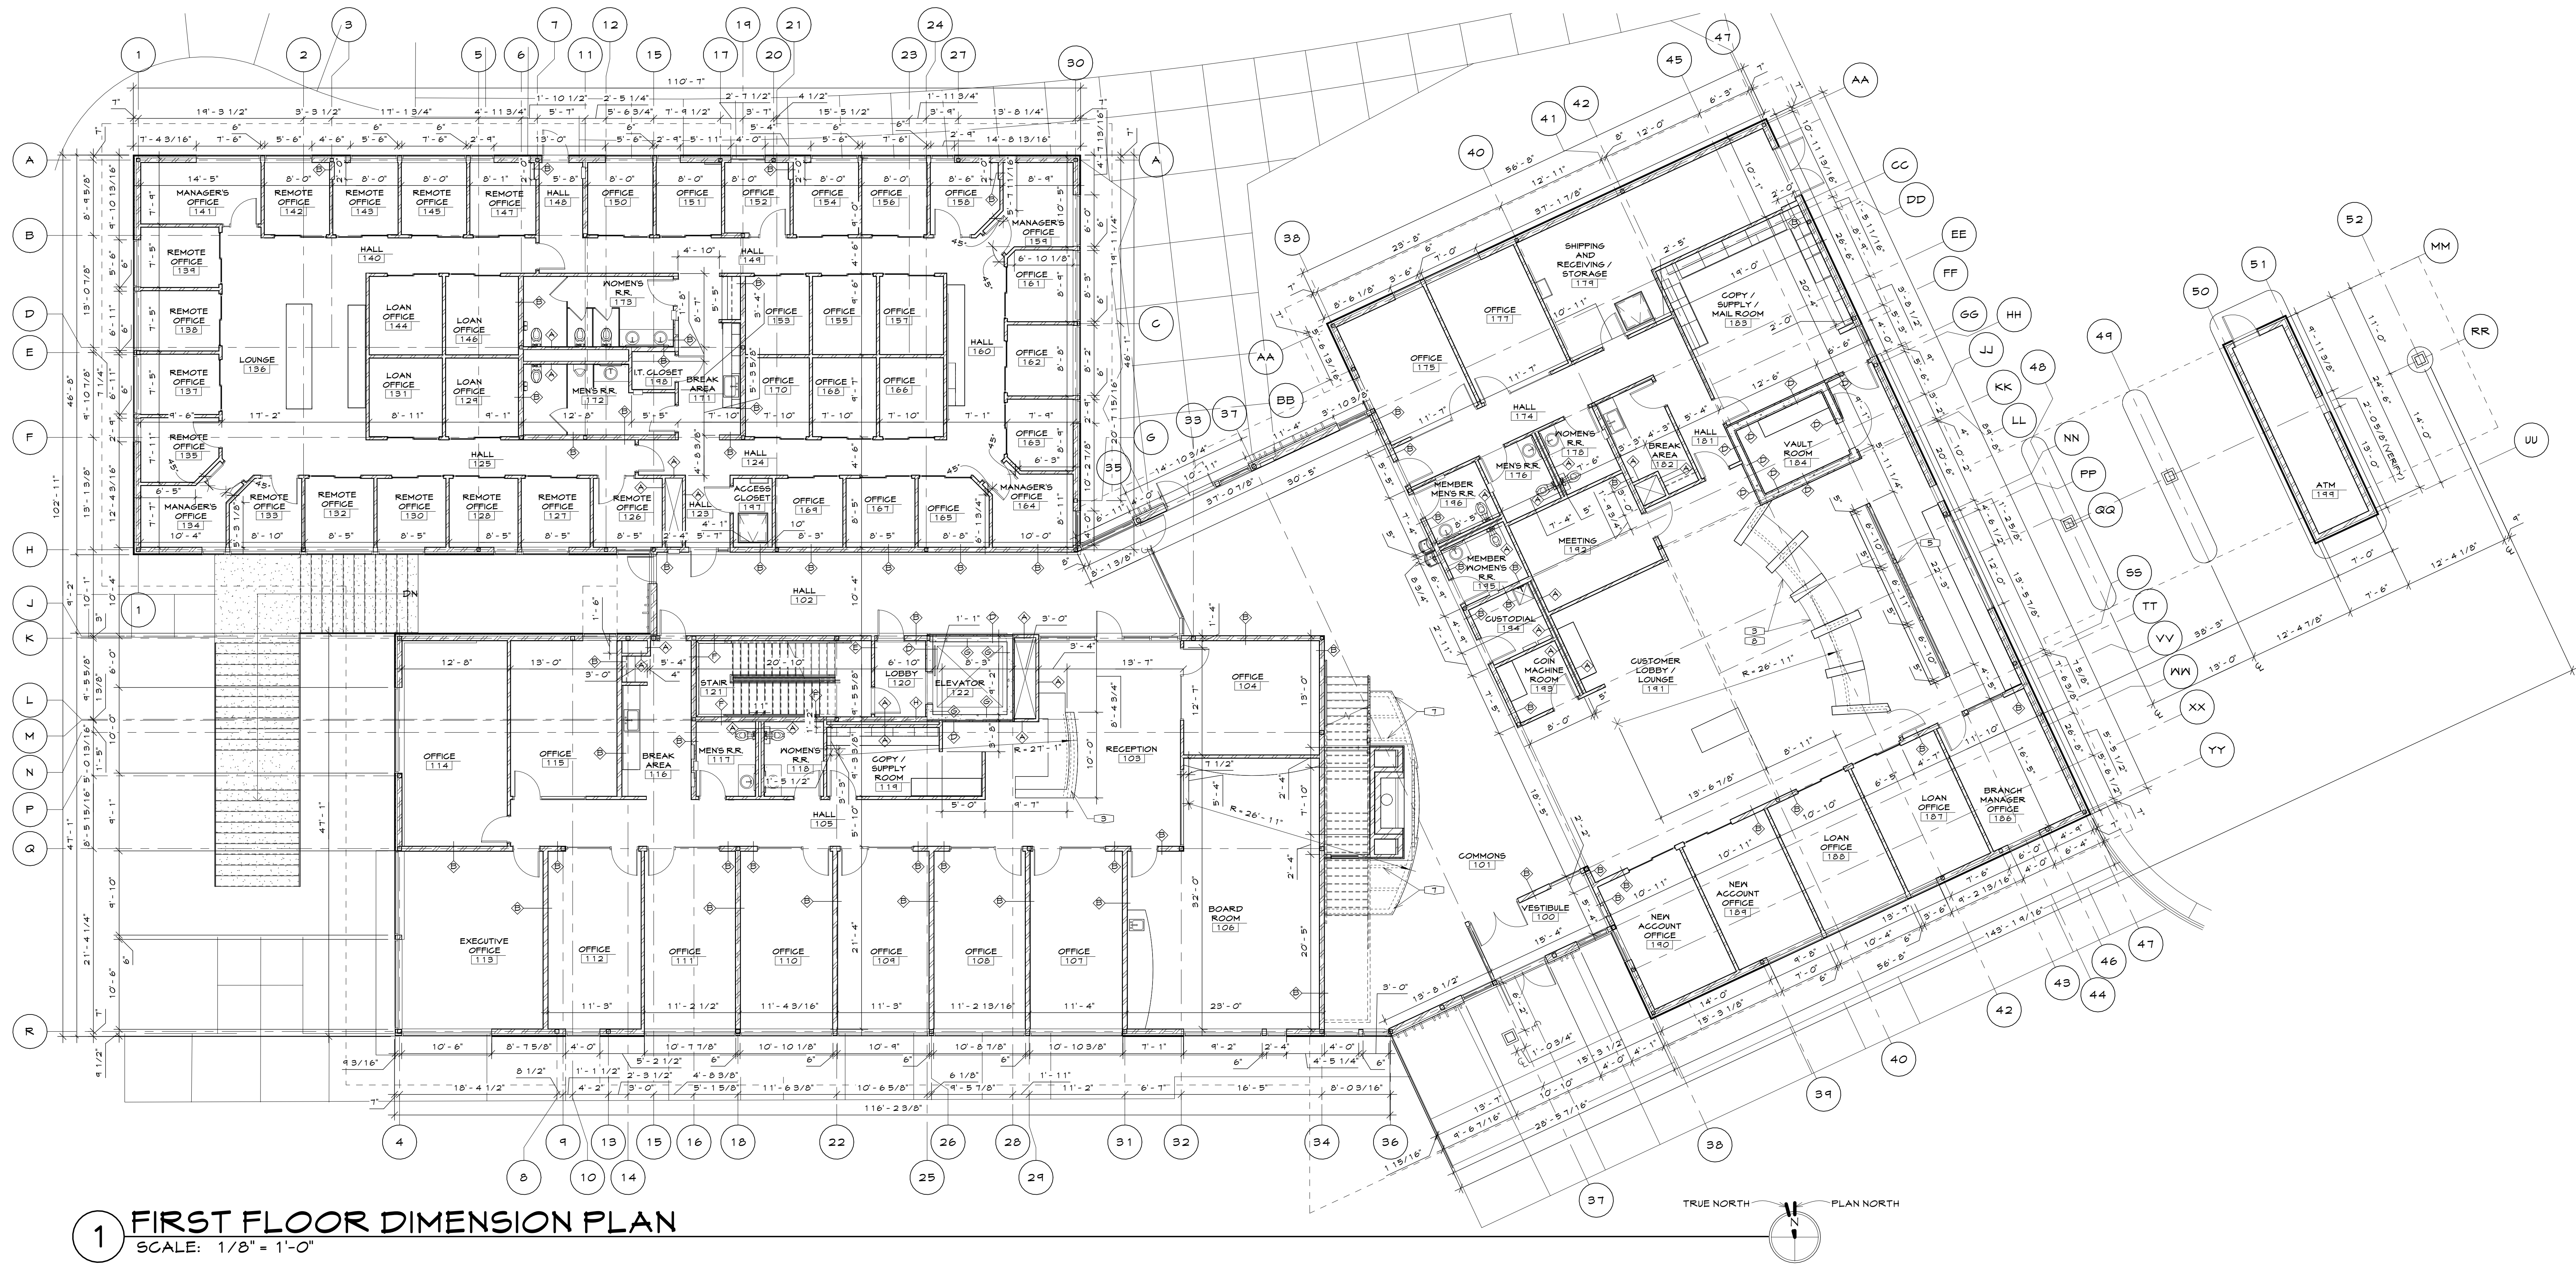

1 FIRST FLOOR DIMENSION PLAN
SCALE: 1/8" = 1'-0"

GENERAL NOTES


- GENERAL NOTES AND LEGEND ON THIS SHEET REFER TO SHEETS 3.10 AND 3.15 ONLY.
- ALL DIMENSIONS ARE TO FACE OF FOUNDATION, FACE OF CONCRETE, FACE OF MASONRY, OR FACE OF STUDS UNLESS NOTED OTHERWISE.
- SEE THE STRUCTURAL, MECHANICAL, AND ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION.
- ALL DOOR AND/OR WINDOW SIZES SHOWN ARE NOMINAL. CONTRACTOR TO VERIFY ALL ROUGH OPENING SIZES WITH DOOR/WINDOW SUPPLIER.
- SEE THE REFERENCE PLAN FOR ADDITIONAL BUILT-IN ITEMS THAT ARE SHOWN ON THIS SHEET BUT ARE DETAILED AND/OR DIMENSIONED ELSEWHERE.
- SEE THE REFLECTED CEILING PLANS AND INTERIOR ELEVATIONS FOR ADDITIONAL SOFFIT AND/OR HEADER FRAMING NOT SHOWN ON THESE SHEETS.
- SEE FINISH PLAN NOTES FOR LOCATIONS OF ABUSE-RESISTANT AND MOISTURE-RESISTANT GYPSUM BOARD AND CEMENT BOARD.

LEGEND

- TYPICAL STEEL STUD WALL - ALL NON-BEARING INTERIOR WALLS TO BE CONSTRUCTED AS FOLLOWS UNLESS NOTED OTHERWISE: 3 5/8" STEEL STUDS AT 16" O.C. WITH FULL BATT INSULATION AND 5/8" GYPSUM BOARD ON EACH SIDE. EXTEND BOTH LAYERS OF GYPSUM BOARD UP TO BOTTOM OF ROOF DECK ABOVE. SEE DETAIL 2.5.10 FOR TYPICAL DEFLECTION HEAD DETAIL AT TOP OF WALL. PROVIDE ACOUSTICAL SEALANT AROUND WALL PERIMETER AND ALL PENETRATIONS TO FULLY SEAL AND PREVENT SOUND TRANSFER BETWEEN ROOMS. PARTIAL HEIGHT WALLS DO NOT REQUIRE INSULATION OR SOUND SEALS.
- STEEL STUD WALL - CONSTRUCT SIMILAR TO TYPICAL STEEL STUD WALL TYPE (ABOVE) EXCEPT WITH (1) LAYER OF 5/8" GYPSUM BOARD ON FINISHED SIDE OF WALL ONLY.
- STEEL STUD WALL - CONSTRUCT SIMILAR TO TYPICAL STEEL STUD WALL TYPE (ABOVE) EXCEPT WITH 8" STEEL STUDS.
- STEEL STUD FURRING WALL - CONSTRUCT SIMILAR TO TYPICAL STEEL STUD WALL TYPE (ABOVE) EXCEPT WITH 1-5/8" STEEL STUDS AND (1) LAYER OF 5/8" GYPSUM BOARD ON FINISHED SIDE OF WALL ONLY AND FILLED WITH 1 1/2" RIGID POLYISOCYANURATE INSULATION.
- STEEL STUD FURRING WALL - CONSTRUCT SIMILAR TO TYPICAL STEEL STUD WALL TYPE (ABOVE) EXCEPT WITH 1-5/8" STEEL STUDS AND (1) LAYER OF 5/8" GYPSUM BOARD ON FINISHED SIDE OF WALL ONLY.
- 1 HOUR FIRE RATED - CONSTRUCT SIMILAR TO TYPICAL STEEL STUD WALL TYPE (ABOVE) EXCEPT WITH (1) LAYER OF 5/8" TYPE X GYPSUM BOARD ON EACH SIDE.
- 1 HOUR FIRE RATED - CONSTRUCT SIMILAR TO TYPICAL STEEL STUD WALL TYPE (ABOVE) EXCEPT WITH 8" STEEL STUDS AND (1) LAYER OF 5/8" TYPE X GYPSUM BOARD ON EACH SIDE.
- 1 HOUR FIRE RATED - 8" CAST-IN PLACE CONCRETE WALL.
- STEEL STUD WALL - CONSTRUCT SIMILAR TO TYPICAL STEEL STUD WALL TYPE (ABOVE) EXCEPT WITH (1) LAYER OF 5/8" GYPSUM BOARD ON FINISHED SIDE OF WALL ONLY AND 8" STEEL STUDS.

KEYNOTES

- PARTIAL HEIGHT WALL BELOW SEE INTERIOR ELEVATIONS FOR BUILT-IN TELLER STATIONS.
- NOTCH IN WALL TO BE 5' - 6" WIDE, 2-7/8" DEEP, AND 42" TALL. LOCATE ACROSS FROM TOR EQUIPMENT FOR CLEARANCE. SEE SHEET 3.9.1.
- PARTIAL HEIGHT WALL BELOW SEE 1-4.4.5.
- SEE ENLARGED PLAN 2/3.15 FOR TELLER LAYOUT.

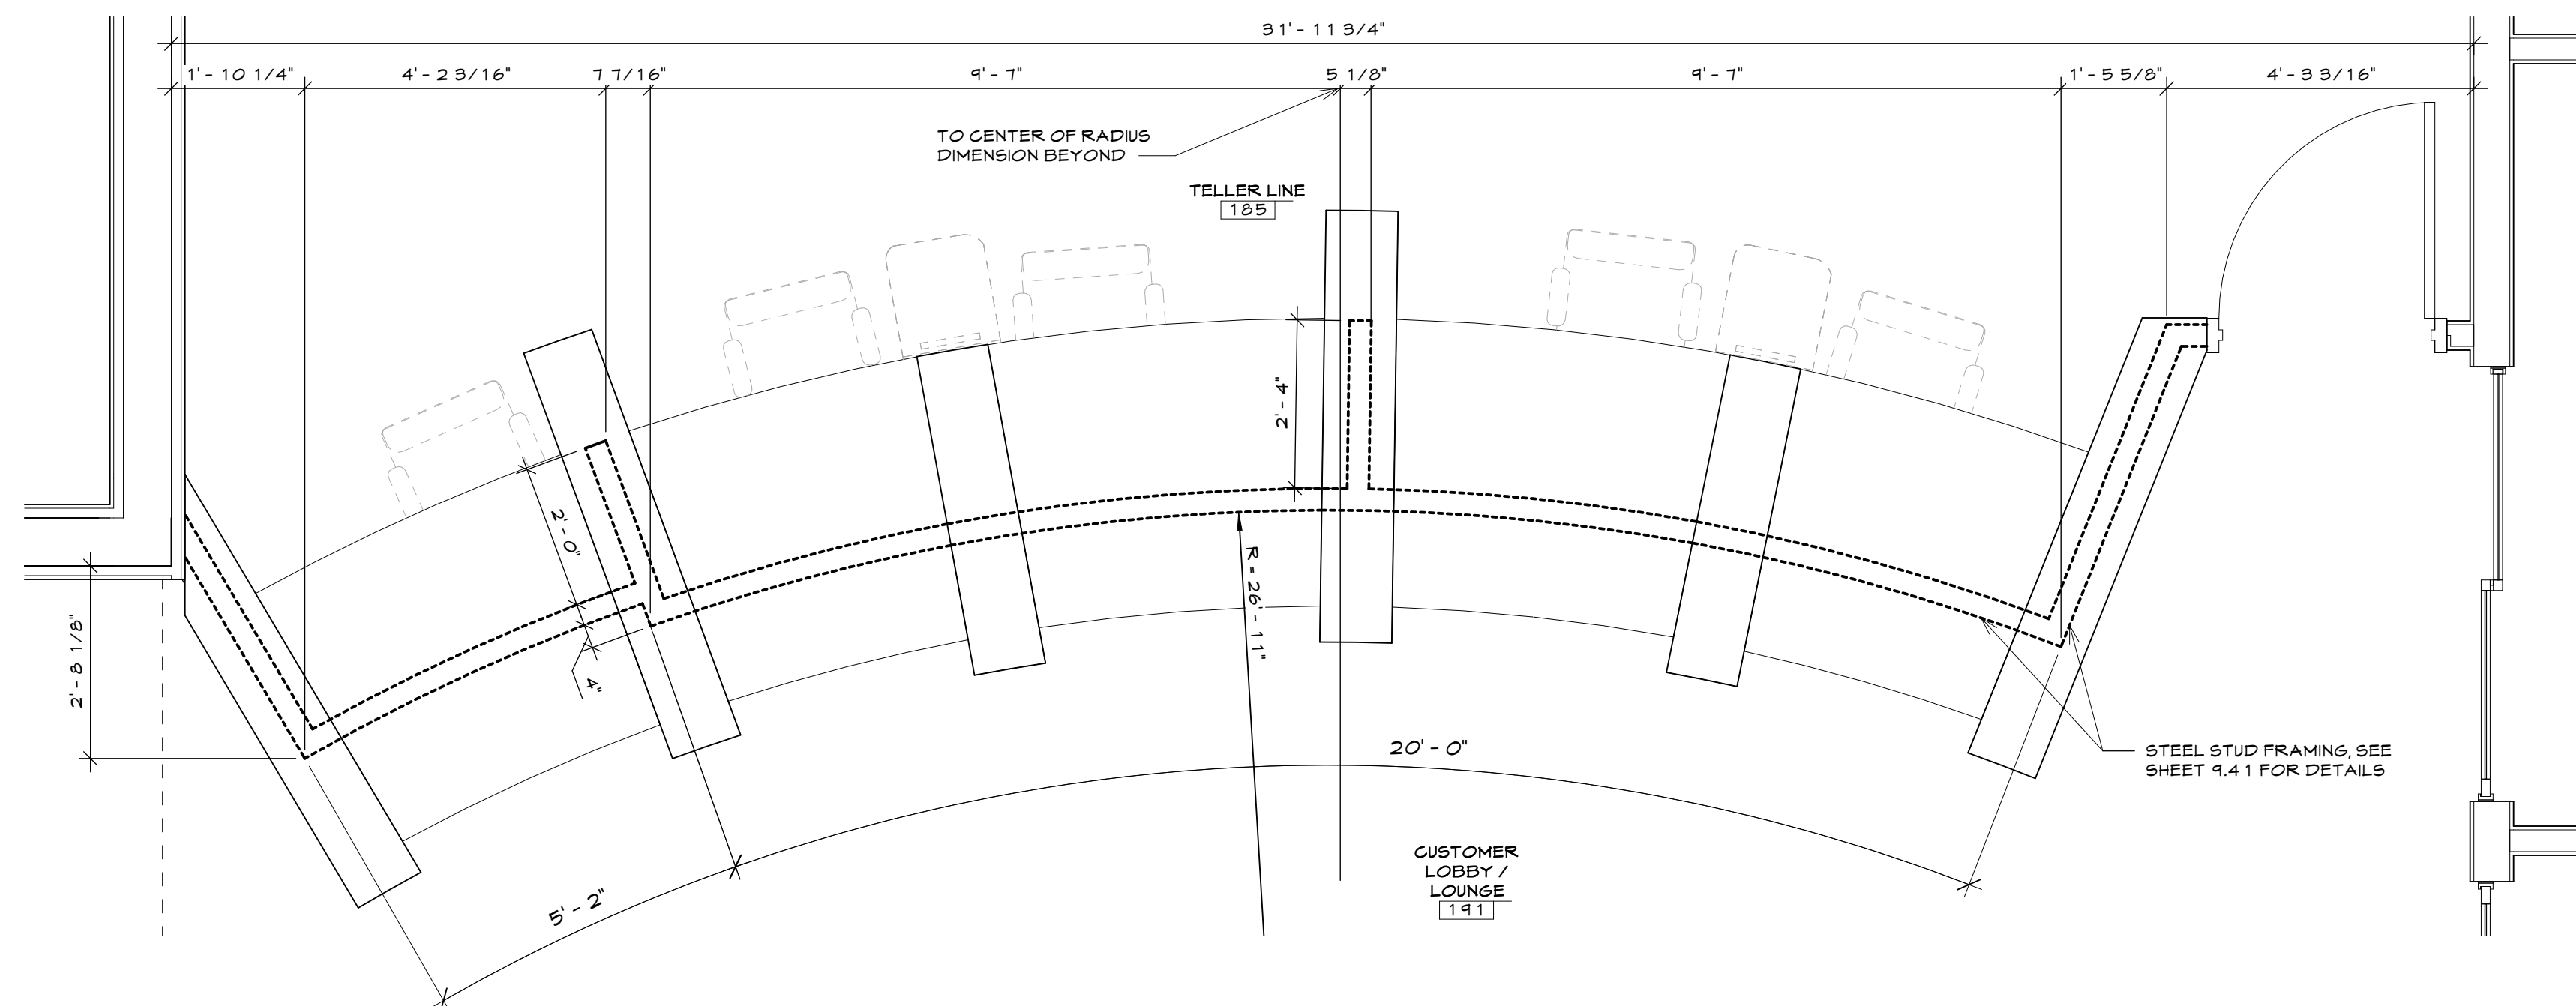

2 ENLARGED TELLER LINE PLAN
SCALE: 1/2" = 1'-0"