
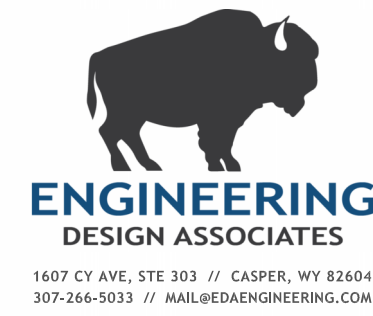


GENERAL NOTES


1. EXISTING CONDITIONS ARE BASED ON AVAILABLE INFORMATION. PRIOR TO SUBMITTING A BID, THE CONTRACTOR SHALL VISIT THE SITE TO VERIFY ALL CONDITIONS AND DIMENSIONS. NO EXTRAS WILL BE GIVEN FOR FAILURE TO INVESTIGATE.
2. MEANS AND METHODS ARE THE RESPONSIBILITY OF THE CONTRACTOR. INCLUDE FOR A COMPLETE INSTALLATION WITHOUT ADDITIONAL COST TO THE OWNER.
3. FIELD ORGANIZE AND INSTALL ALL EQUIPMENT, DUCTWORK, PIPING, CONDUIT, ETC. FOR MAINTAIN CLEARANCE AND MAINTENANCE ACCESSIBILITY. (ALL TRADES)
4. EXISTING PIPING, DUCTWORK AND EQUIPMENT SHOWN LIGHT. NEW PIPING, DUCTWORK AND EQUIPMENT SHOWN BOLD.
5. EXISTING PIPING, DUCTWORK AND EQUIPMENT TO REMAIN OR THAT WHICH IS NOTED TO BE REUSED SHALL BE PROTECTED FROM DAMAGE.
6. MOUNT ALL EQUIPMENT HIGH AND TIGHT TO STRUCTURE.

KEY NOTES

1. INSTALL NEW CONDENSATE LINES FOR EACH NEW FAN COIL PER MFG'S INSTRUCTIONS. EXTEND AND CHARGE LINES AS REQ'D AND NAME. CONNECTION THE EXISTING CONDENSATE LINE AS INDICATED.
2. EXTEND NEW SANITARY WASTE, VENT AND DOMESTIC WATER LINES DOWN TO THIS LOCATION FOR CONNECTION TO THIS NEW SINK LOCATION. ALL LINES SHALL BE LOCATED IN THE WALL CHASE AND HIDDEN FROM VIEW.
3. RELOCATE EXISTING FIRE PROTECTION MAIN LINE AND LATERAL BRANCH LINES PER RENOVATIONS SHOWN. RELOCATE FIRE PROTECTION HEADS PER NEW WALL LOCATIONS. ADD ADDITIONAL HEADS TO PROVIDE ADEQUATE PROTECTION PER NFPA-11 REQUIREMENTS. FIRE SPRINKLER ENGINEER BY G.C. COORDINATE WITH ALL TRADES PRIOR TO INSTALLATION. RE-CERTIFY THE SYSTEM AS REQ'D.

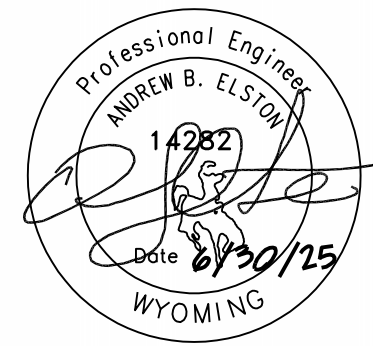

OLD STONEY REMODEL
PHASE TWO
120 NORTH 4TH STREET
SUNDANCE, WYOMING 82729

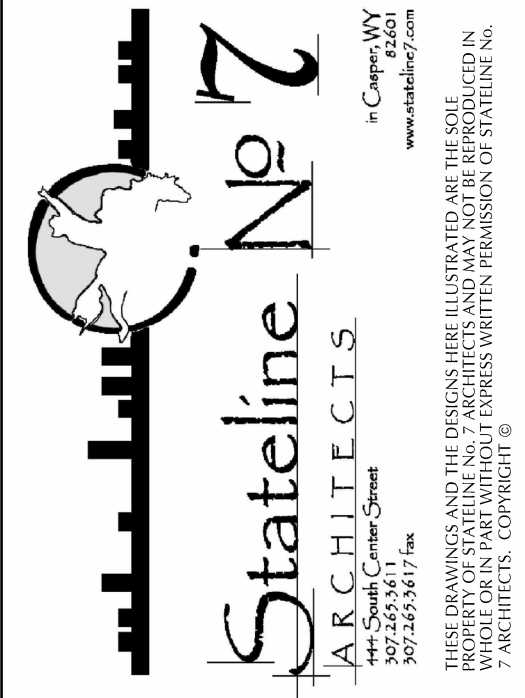

PROJECT
16-022/25004

DATE
06-30-25

DRAWN BY
KRD

DISK ID.

SHEET
BASEMENT FLOOR
ALTERNATE #6
WASTE & VENT
RENOVATION

SHEET

